

This test report replaces the test report EUFI29-23000306-T1 dated in 22 January 2023. Structure of the specimen corrected, addition of the definition of the substrate and addition on deviation section.

Determination of external fire exposure to roofing of FATRAFOL 810/V (1,2 mm) according to CEN TS 1187:2012, Test 2

Requested by	Bestor Group AS Taavi Ossip Valdeku 168 EE-11217 Tallinn taavi.ossip@bestor.ee
Contact person	Eurofins Expert Services Oy Taru Huokuniemi Kivimiehentie 4 FI-02150 Espoo, Finland taruhuokuniemi@eurofins.fi
Products	The customer gave the following information about the products: <u>Top layer</u> <ul style="list-style-type: none">• Product name: FATRAFOL 810/V (1,2 mm)• Product description: roofing membrane on the basis of PVC-P reinforced with a polyester grid• Nominal mass per unit area: 1430 g/m²• Thickness: 1,2 mm• Manufacturer: Fatra, a.s., třída Tomáše Bati 1541, 763 61 Napajedla, Česká republika <u>Glass fleece</u> <ul style="list-style-type: none">• Product name: microlith® - glass fiber mat• Nominal mass per unit area: 120 g/m²• Manufacturer: Alpax s.r.o. , Terronská 19/580 ,160 00 Praha 6, Česká republika <u>EPS insulation board</u> <ul style="list-style-type: none">• Product name: EPS S• Thickness: 100 mm• Manufacturer: BACHL, spol.sr.o., Evropská 669, 664 42 Modřice, Česká republika <u>Poyuethylene foil (PE foil), vapour control barrier</u> <ul style="list-style-type: none">• Product name: fatrapar 200• Nominal thickness: 0,2 mm0,2• Manufacturer: PYTLÍK, a.s., IČ: 26459990, Bečovská1326/9, 104 00 Praha 10 – Uhřetíněves, Česká republika

Samples

The sample of the product was chosen and test specimens were made by the customer.

Date of delivery: 20 January 2023

Sample: Test specimen of the product

Top layer

Thickness: 1,2 mm

Nominal mass per unit area: 1430 g/m² (controlled by EES)

Glass fleece

Thickness: 0,6 mm

Nominal mass per unit area: 120 g/m² (controlled by EES)

EPS insulation board

Thickness: 100 mm

Nominal weight per unit area: 14 kg/m³ (controlled by EES)

PE-foil

Thickness: 0,2 mm

Nominal weight per unit area: 149 g/m² (controlled by EES)

Wood particle board substrate

Nominal density: 581 kg/m³ ((controlled by EES)

Date of delivery: 27 April 2023

Top layer

Thickness: 1,2 mm

Nominal mass per unit area: 1430 g/m² (controlled by EES)

Glass fleece

Thickness: 0,7 mm

Nominal mass per unit area: 120g/m² (controlled by EES)

EPS insulation board

Thickness: 100 mm

Nominal weight per unit area: 14 kg/m³ (controlled by EES)

PE-foil

Thickness: 0,2 mm

Nominal density: 150 g/m² (controlled by EES)

Samples were controlled by Eurofins Expert Services

Test specimens	<p>Eight test specimens were made by the customer with dimensions of 400 mm x 1000 mm</p> <p>Structure of the specimens from substrate to top layer:</p> <ul style="list-style-type: none">– wooden particle board, mechanically attached– PE foil, mechanically attached– EPS insulation board, mechanically attached– glass fleece, mechanically attached– FATRAFOL 810/V (1,2 mm)
Date of tests	2 February 2023, 6 May 2023
Test method	<p>CEN TS 1187:2012, Test methods for external exposure to roofs - Test 2: Method with burning brands and wind.</p> <p>A description of the test method and the classification criteria of $B_{ROOF}(t_2)$ given in the classification standard EN 13501-5:2016 and concerning Test 2 are presented in Appendix 1</p>
Test results	Test results are presented in Appendix 2
Deviation	Six test specimens have been tested with the wood particle board substrate with density of 581 kg/m^3 . Test standard CEN /TS 1187:2012 defines density of standard wood particle board substrate to be $680 \pm 50 \text{ kg/m}^3$. Two additional test were made with standard wood particle board with density $680 \pm 50 \text{ kg/m}^3$. The deviation did not have an influence on the final result of the tested samples.
Note	<p>The results relate to the behaviour of the test specimen of a product under the particular conditions of the test, they are not intended to be the sole criterion for assessing the potential fire hazard of the product in use.</p> <p>Eurofins Expert Services Oy is a notified body 0809 concerning the Construction Products Regulation (CPR).</p>

Espoo, 8 May 2023

Taru Huokuniemi

Senior Expert

Appendices

Appendix 1, Description of the test method and the classification criteria of B_{ROOF}(t₂)
Appendix 2, Test results

Distribution

Customer Electronically approved

DESCRIPTION OF THE METHOD

CEN TS 1187:2012 *Test methods for external fire exposure to roofs*

Test 2: *Method with burning brands and wind*

Test specimens

The size of test specimens are 400 mm x 1000 mm and number of specimens is six.

Test specimens are normally prepared by attaching the product to a standard substrate. The specimen may also be tested on a non-standard substrate, in which case the test results are valid for that substrate only.

The standard combustible substrates are:

wood particle board, density (680 ± 50) kg/m³, thickness (19 ± 2) mm

expanded polystyrene (EPS) (not fire retarded treated), density (20 ± 5) kg/m³, (50 ± 10) mm

The standard non-combustible substrates are:

fibre reinforced calcium silicate board, density (680 ± 50) kg/m³, (10 ± 2) mm

mineral wool, density (150 ± 20) kg/m³, thickness (50 ± 10) mm

The test specimens are conditioned prior the tests to constant mass in a room with a temperature of 23 ± 2 °C and relative humidity of 50 ± 5 % RH.

Test procedure

The test specimen is mounted in the test apparatus at an angle of 30° to the horizontal plane. A burning wooden crib (100 mm x 100 mm, 40 g) is placed on the test specimen with its centre 100 mm from the bottom edge of the specimen. Three tests are performed with air velocities along the specimen of 2 m/s and 4 m/s respectively.

During the tests the time at which the test specimen ignites, the time at which the flames die out, the time at which the glow dies out and the behaviour of the test specimen are observed and recorded.

The test is terminated by extinguishing of the fire on the specimen 15 min after the start of the test or when the flame front has reached the upper end of the specimen. After the test the test specimen is examined and the extent of damages done to both the roof covering and the substrate are measured.

CLASSIFICATION CRITERIA – B_{ROOF}(t₂)

The classification criteria are given in the classification standard EN 13501-5:2016 "*Fire classification of construction products and building elements - Part 5: Classification using test data from external fire exposure to roof tests*."

Classification parameters of Test 2 are mean damaged length and maximum damaged length of the roof covering and the substrate. Classification criteria of B_{ROOF}(t₂) for both test series at 2 m/s and 4 m/s wind speed are

- mean length of damage in the roof covering and substrate $\leq 0,550$ m
- maximum length of damage in the roof covering and the substrate $\leq 0,800$ m

VALIDITY OF CLASSIFICATION

Depending on quality and density of the substrate used in tests the classification is valid for

- non-combustible substrates with density of at least 0,75 times the density of the substrate used in tests
- combustible and non-combustible substrate with density of at least 0,75 times the density of the substrate used in tests

6.9.2018

TEST RESULTS

Test method: CEN TS 1187:2012, Test 2
Product: FATRAFOL 810/V (1,2 mm)
Substrate: Wood particle board (density 581 kg/m³)
Date of test: 2 February 2023

Table 1. Test results *FATRAFOL 810/V (1,2 mm) + glass fleece + PE-foil + EPS insulation board + wood particle board substrate*

Wind velocity	2 m/s				4 m/s				
	Test No.	1	2	3	Mean	1	2	3	Mean
Covering ignited, min:s		00:12	00:12	00:13	00:12	00:13	00:13	00:12	00:13
Flames extinguished, min:s		02:49	03:16	02:30	02:52	02:45	03:25	03:23	03:11
Glowing ended, min:s		11:06	10:45	11:09	11:00	07:04	08:21	08:53	08:06
Length of damage in membrane, mm*		428	442	409	426	505	525	510	513
Length of damage in substrate, mm*		0	0	0	0	0	0	0	0

*) Measured from the middle of the ignition source

TEST RESULTS



Test method: CEN TS 1187:2012, Test 2
Product: FATRAFOL 810/V (1,2 mm)
Substrate: Standard wood particle board (density $680 \pm 50 \text{ kg/m}^3$)
Date of test: 6 May 2023

Table 2. Test results *FATRAFOL 810/V (1,2 mm) + glass fleece + EPS insulation board + PE-foil + standard wood particle board*

Wind velocity	2 m/s				4 m/s				
	Test No.	1	2	3	Mean	1	2	3	Mean
Covering ignited, min:s	00:12				00:12	00:13			00:13
Flames extinguished, min:s	04:21				04:21	03:01			03:01
Glowing ended, min:s	12:03				12:03	06:43			06:42
Length of damage in membrane, mm*	485				485	492			492
Length of damage in substrate, mm*	0				0	0			0

*) Measured from the middle of the ignition source

Pictures from test date 2 February 2023, with substrate density 581 kg/m³

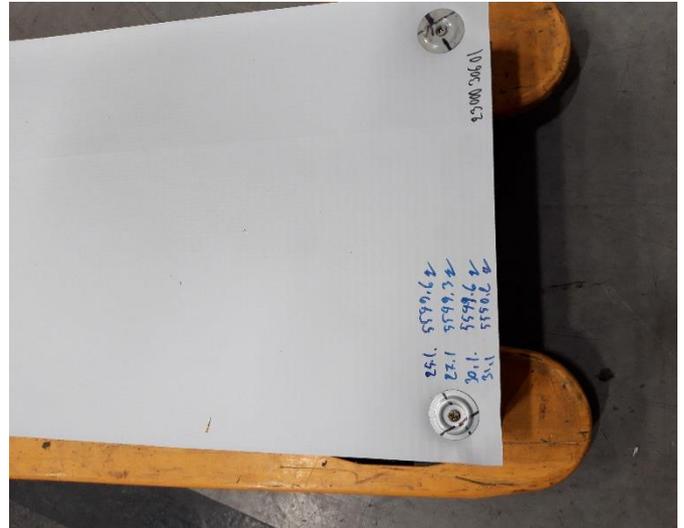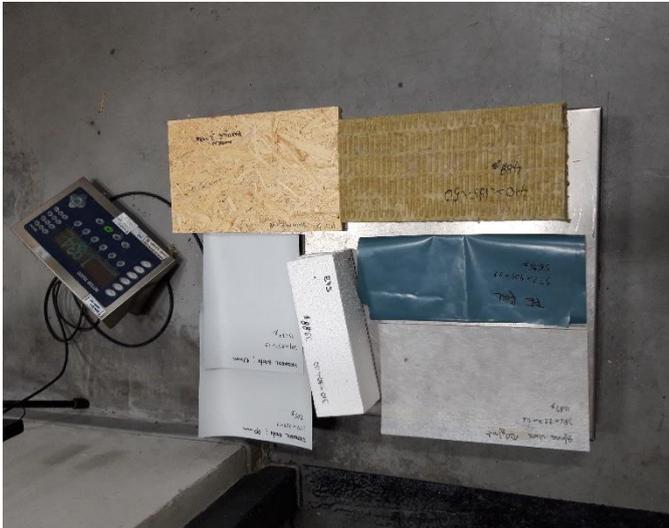

Pictures from test date 6 May 2023, with substrate density $680 \pm 50 \text{ kg/m}^3$

